



AWX2000PAC

HEPA AIR FILTRATION SYSTEM



The 2000PAC HEPA Filtration System purifies the air of airborne contaminants which could be biological, chemical or particulates. When connected to a mobile isolation containment it creates negative pressure, providing isolation between operating room and the outside environment. All the air pulled from the containment is purified through 99.99% HEPA and by high intensity UVGI light before it is exhausted into the general area. Carbon filters can also be added to the machine to remove chemical odors.

855-668-8400 | www.airworkx.com | info@airworkx.com

PRODUCT SPECIFICATIONS:

Net weight (with filters)	140 lbs.
Dimensions (LxWxH)	26"x20"x46"
Operating Speeds	Variable Speed Controller
Airflow Ratings	200 to 1800 CFM
Filtration Stages	3-4
99.99% HEPA Filter, Medical Grade	Standard
Cabinetry	Aluminum, Closed End Rivet
Silicon Sealed Seams before Riveting	Yes
Push Handle	One
Casters	Four, 3" Swivel
Motor Horse Power	1 hp
Circuit Requirements (Volts/Hz)	115 VAC/60 Hz
Maximum Operating Amps	12.5 Amps
Thermal Overload Protection	Yes
Pressure Gage	0-3" W.C.

Optional Accessories:

- Intake/Exhaust Manifold 10" diameter ring
- Hose clamp, 10" diameter
- Flex hose 10" diameter
- Stainless Steel Quick Clamp
- *Optional: 10" Wheels combined with 3" Casters

<p><u>PARTS:</u> AWX2000PAC HEPA Filtration System HEPA filter—99.99% @ 0.3 micron, Size 24" x 18" x 12" Primary filter—MERV 11 pleated filter Intake Manifold—Durable ABS plastic, Size 26" x 20" with 10" diameter ring for flex duct connection Flexible Duct—10" diameter, 3' length including Hose Clamp <u>OPTIONAL ACCESSORIES:</u> OdorGuard 600—Carbon filter pad, Size 24" x 16" x 2" (Mesh or Pleated) OdorGuard 750 Plus— Carbon/Alumina/Potassium permanganate filter pad, Size 24" x 16" x 2"</p>
--



3067108

CONFORMS TO UL STD 507
CERTIFIED TO CAN/CSA STD C22.2 NO. 113-M1984

Figure 1. AWX2000PAC Parts and Accessories



INSTRUCTIONS

Unpacking:

Carefully check the unit for damage. Remove the exhaust cover grill and check the HEPA filter. It should be seated, the filter should be flush with the mounting brackets and the brackets should be compressing the filter down.

The optional Intake Manifold (see Figure 1) provides flex hose connection and holds the primary pleated filter in place. Intake Manifold can be used on intake or exhaust side in place of the screen. The manifold is secured by four thumb screws.

Operation:

While the AirWorkx PAC machine can operate outside the containment, it is recommended to protect it from the rain and dirty environment. **For the following operation instructions, we are assuming that the machine is located inside the enclosure.** If the machine is located outside the containment, the flex hose connections would be reversed.

To create positive pressure inside the containment, more air has to be pumped in than leaks out. Connect the flex hose from the outside to the Intake Manifold on the suction side of the machine. The outside air is pulled through primary/secondary filter under a negative pressure. This prevents leakage of untreated air into the containment. Then the air passes through blower and over the UVGI lights, where it is sterilized and pushed through the HEPA filter to remove any particulates. The pure air stream, diffused by HEPA is then exhausted into the containment. The plastic sides of the containment should be bowed out to indicate positive pressure. The speed of the machine can be adjusted to meet your required number of air exchanges and the positive pressure.

To maintain negative pressure inside the containment in reference to ambient pressure, more air has to be exhausted out than leaks into the containment. Install the Intake Manifold on the outlet side of the machine and connect the flex hose to the outside. All the air exhausted to the outside is treated by UVGI lights and by HEPA filter. The plastic walls of the containment will be bowed in, indicating negative pressure. By increasing fan speed, the pressure inside the containment becomes less than the outside pressure.

As the doors to containment open, the pressure will temporarily change and return to normal when the doors close. The higher the speed, the faster the room will return to desired pressure. As the HEPA filter loads with dust, the speed will have to be increased to reach the same airflow and to maintain the desired pressure inside the containment.

INSTRUCTIONS (Continued)

The PAC HEPA Filtration system must always operate with the HEPA filter in place to prevent contamination of the area and electrical overload of the motor.

Operating UV Germicidal Lights

UVGI lights are installed in the compartment facing the HEPA filter. The air passing by the UVGI lights is sterilized and the bio-contaminants captured on the HEPA are killed or deactivated.

The UVGI lights should be turned on before the fan starts to run and should stay on after the air blower is stopped to complete the sterilization of the HEPA filter. The proper operation of the UVGI lights is monitored by UVGI and BALLAST indicating LEDs which turn on when the UVGI lights are on.

Operating the PAC System:

The PAC system should be connected to containment outlet with flex duct to create a negative or positive pressure in the room. The machine can also provide air purification as a self standing unit if desired.

Figure 2. Rear view of the AWX2000PAC:



Manifold Installation:

Intake Manifold rests in a bottom and top channel.




Figure 3. HEPA Filter Installed in Unit

Machine shown resting on the handle for filter installation

Note: HEPA filter gasket must be flat against internal flange.



Figure 4. Close up of tabs for HEPA element



HEPA filter element mounting tab

INSTRUCTIONS (Continued)

Before starting the blower, **turn on the UVGI lights**. Check that the **Ballasts** and **Lamps** status lights came on. We recommend leaving the UVGI light on for another 10 minutes, after the air flow is turned of to sterilize the inside of the compartment and the intake side of the HEPA filter.

The start and speed of the machine is controlled by the toggle switch **HIGH / SPEED CONTROL** and the variable **SPEED CONTROLLER** knob.

To start the machine in the highest speed, place the toggle switch in **HIGH** position. To start the machine at reduced speed, place the toggle switch in **SPEED CONTROL** position and turn the knob clockwise from **OFF** to start the blower. The machine starts at **HIGH SPEED** and the speed is reduced by turning the knob clockwise to desired air flow.

The machine can be switched between the desired controlled speed setting and the highest speed at any time by toggle switch being moved between **SPEED CONTROL** and **HIGH**. The toggle switch overrides the **SPEED CONTROLLER** knob setting and runs the blower at its highest speed. This is also used as a quick check of HEPA filter loading and required filter change (see Maintenance).

Maintenance:

Mechanical and Electrical -

The motor and blower do not require any maintenance when the machine is operated with the HEPA filter in place.

The UVGI lights should last over 15,000 hours of operation. There are two high intensity lights UVGI lights and two ballasts. The LED indicating lamps turning OFF will indicate a light tube or ballast failure. The UVGI tubes and ballasts can be accessed by removing the HEPA filter. **Do not look directly into the UVGI lamps while they are operating, this could damage your eyesight.**

Filter Replacement -

When replacing the HEPA filter, proper care should be taken to wear a respirator in combination with the necessary PPE. The filter should be disposed of in an appropriate manner based on the contaminants it was exposed to. The HEPA filter element is held in place by metal tabs and can be accessed from the top of the unit. To remove the element, remove the metal grate, unscrew the nuts on the tabs and remove the tabs. Lay the machine down on the handle and slide the element out. Slide the new filter element into place with the gasket side of the HEPA filter facing the blower unit. Make sure that the HEPA filter is seated well against the internal flange. Place the machine back in the upright position, replace the filter tabs and nuts and tighten to compress the gasket by 1/8". Do not over tighten the bolts as this may crack the gasket. When replacing the HEPA filter, the primary filter should also be replaced.


The primary filter is located behind the Intake Manifold and should be checked or replaced monthly. To access the filter, remove the manifold and install a new pleated filter. Observe the air flow arrow on the filter.

The HEPA filter efficiency of 99.99% will not degrade when the filter is loaded with dust, but the air flow will be reduced. The HEPA filter should be replaced when:

1. The air flow from the machine is not sufficient to maintain the desired negative pressure in ICOROOM enclosure.
2. The machine must run in high speed all the time to maintain the ICOROOM negative pressure, which causes excessive noise.
3. HEPA filter is more than 80% loaded. (See note below)

NOTE: The loading of the filter can be checked by switching the machine to **HIGH** speed after replacing the primary filter and reading the pressure gauge "WC". With all filters clean, the gauge should indicate 1.2" to 1.3" WC. A reading of 2.6" WC indicates the filter is 80% plugged and should be replaced.

REFERENCE MATERIALS:

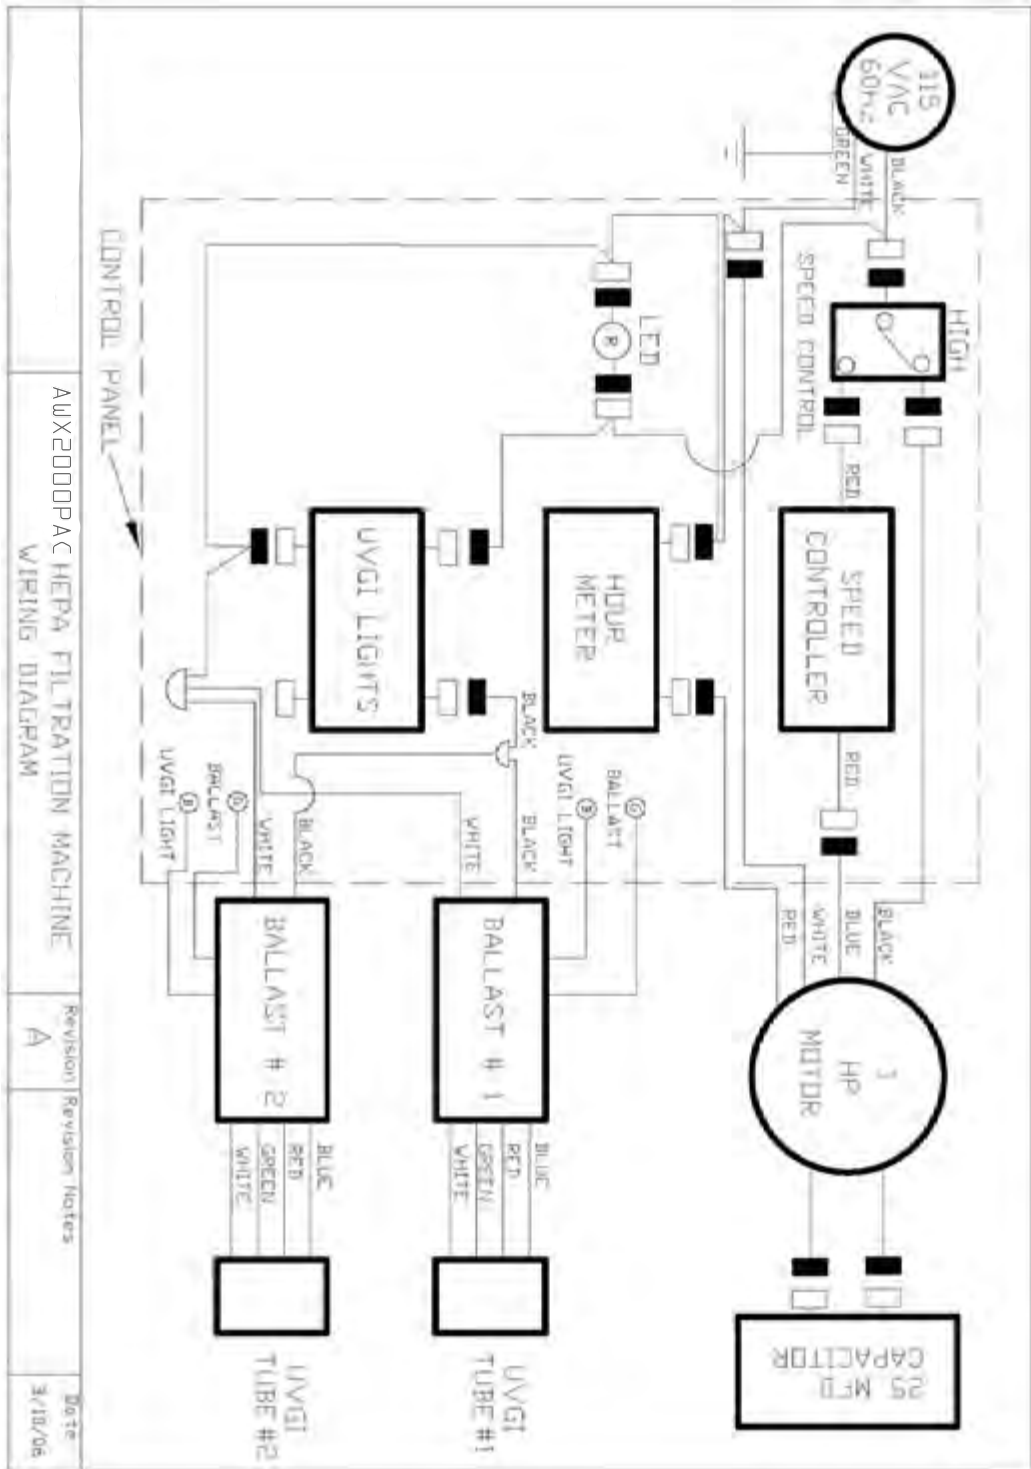

AWX2000PAC HEPA FILTRATION MACHINE
WIRING DIAGRAM

Revision: A
Revision Notes

Date: 3/18/06

AirWorkx Portable Air Cleaners for First Response Shelters

AirWorkx PAC with HEPA and UVGI lights have been designed specifically to meet CDC requirements for clean, filtered air in a medical environment. Each air filtration system is equipped with a medical grade, metal frame, HEPA filter element that has been factory tested and certified as 99.99% efficient at 0.3 microns.

The AIRWORKX PAC units can be paired with Environmental Containment Units to provide a comprehensive solution by providing a durable, standardized, prefabricated containment for quick emergency response.

Available Models

AirWorkx 800 PAC: Compact size, variable airflow; 150-600 CFM, Weight: 75 lbs

Size: 36”H X 15”W X 15”D

AirWorkx 1200 PAC: Versatile, variable air flow for larger areas; 200-1100 CFM, Weight: 115 lbs,

Size: 40”H X 23”W X 20”D with wheels

AirWorkx 2000PAC: Most powerful model with the largest range of variable airflow; 200-1800 CFM,

Weight: 125 lbs, Size: 40”H X 24”W X 29”D with wheels



Optional Wheel/Caster combination